

WHITEPAPER - YELLOW FIBRE DUCT PATHWAY

Congestion in Data Centres

Table of Contents

Engineering for Change Velocity and Future Capacity	3
Why Congestion Happens	4
Quantifying Capacity	6
Bend Radius Risk	8
Engineering Strategies	10
Designing for Future Capacity	13
Fire Safety & Compliance	16
Where Elevate Yellow Fibre Duct Fits	17
Technical Field Checklists	18
Governance, Lifecycle Control	21
Designing Pathways for Change	22

Engineering for Change Velocity and Future Capacity

A practical, design-led framework for operators and consultants, using Elevate Yellow Fibre Duct as a modular pathway platform.


Abstract

Pathway congestion within overhead fibre ducting (“yellow duct”) is increasingly a constraint on data centre agility. The impact is not limited to aesthetics or housekeeping; it manifests as increased MAC risk, slower delivery velocity, and higher lifecycle cost due to remedial work and re-routing. In parallel, uncertainty in demand growth and technology refresh cycles makes it difficult to “size once” and rely on a static pathway design.

This whitepaper provides a technical framework for:

- ✓ **Diagnosing congestion**
- ✓ **Quantifying usable pathway capacity**
- ✓ **Designing for modular expansion.**

It also demonstrates how Elevate Yellow Fibre Duct - a modular LSZH, flame retardant ducting system with a wide accessory set and multiple width options - supports a structured approach to governance, expansion, and maintainability.

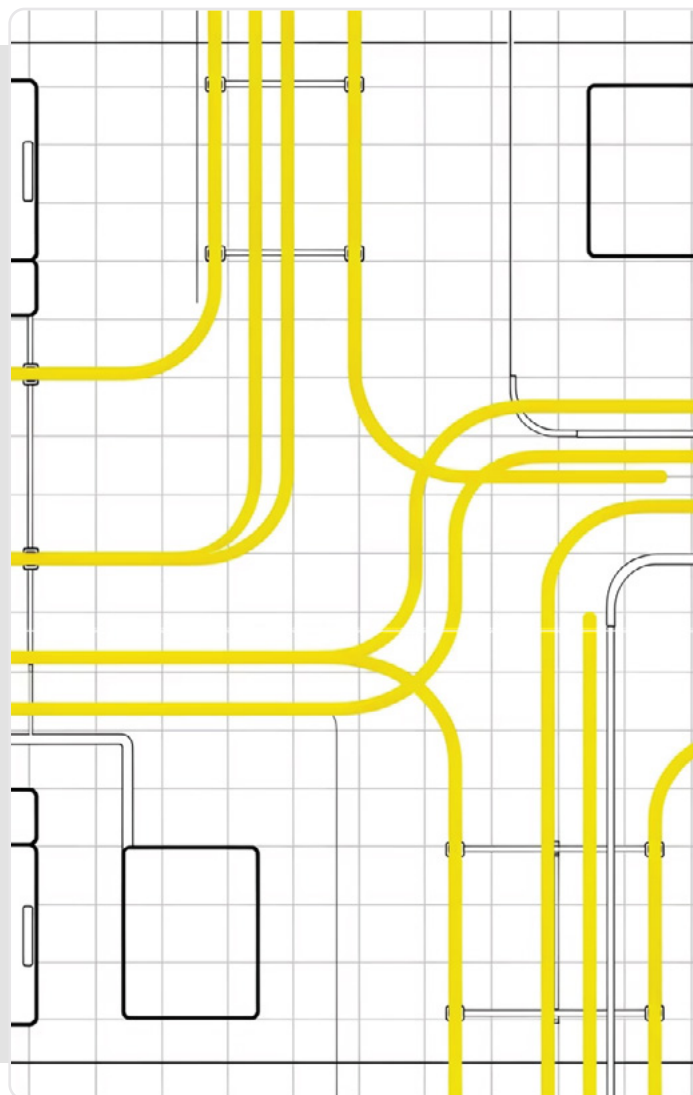

Why Congestion Happens: The Physics And The Operational Reality

“Space” is Not the Same as “Usable Capacity”

A duct can appear “not full” by visual inspection and still be functionally congested. Usable capacity is constrained by factors that are invisible to a cursory glance, and experienced engineers understand that the gap between physical fill and operational headroom is where risk accumulates.

Three principal constraints determine usable capacity:

Bend Radius Envelopes

The volume required for cables to turn at entry/exit points and direction changes without violating minimum bend radius. These zones are effectively unusable for additional cable routing.


Bundle Packing Inefficiency

Voids between round cables, deformation of bundles under compression, and the space consumed by tie materials - all reduce theoretical fill to practical fill.

Access Requirements


Safe adds and changes require hands/tools space, visibility, and the ability to route new cables without disturbing live services. This is not discretionary - it is a risk management requirement.

This is precisely why fill ratio rules exist, and why experienced designers treat the “maximum allowed” as an absolute ceiling – **never a target.**

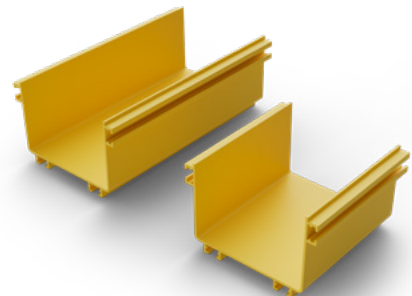


Congestion is Amplified by Change Velocity

In environments where ducts function as active pathways - with cables entering and exiting frequently - effective fill must be substantially lower than in “through-only” pathways. Entry/exit bends and rework consume space disproportionately, creating a compounding effect that accelerates the onset of congestion.

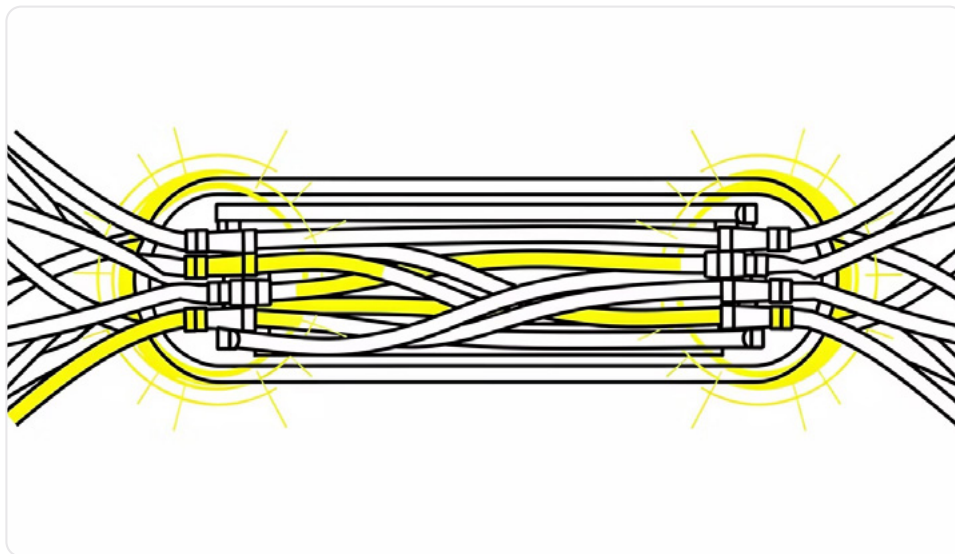

In busy areas of a data centre - like MDA or HDA cross-connect zones - things change so often that you can't safely fill the cable trays or pathways to their full physical capacity.

In reality, you have to stop much earlier, usually 15–20% below the actual maximum, so there's enough room to move, add, or replace cables without causing a mess or creating risks.

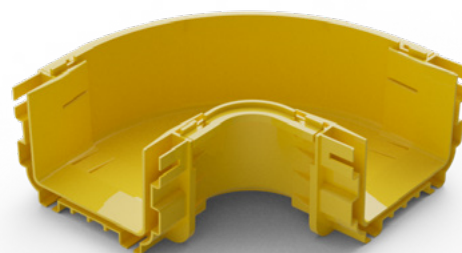

Quantifying Capacity: A Practical Engineering Method

Consultants and operators respond well to simple, auditable methods. The following approach provides robust capacity assessment without requiring perfect data.

Use Area-Based Fill, Not “It Looks Full”

For rectangular duct/trunking, capacity should be treated as an engineering calculation rather than a visual assessment. The method is directly comparable to conduit and cable tray planning practice:

Duct Internal Area

Width × Height (minus any internal features)

Cable Area

$\Sigma (\pi \times (OD/2)^2)$ for each cable in the duct

Fill Ratio

$\text{Cable Area} \div \text{Duct Internal Area} \times 100\%$

Apply Fill Ratios That Preserve Lifecycle Agility

Pathway fill ratios are not arbitrary bureaucratic constraints - they encode the operational experience of generations of infrastructure engineers. The following guidance reflects commonly referenced industry practice:

25–30% Design Fill

High-change areas - MDA/HDA cross-connect zones, frequent drop points. Preserves maximum change velocity and access headroom.

40% Design Fill


Stable trunk routes with lower change frequency. Hard ceiling defined by site standards and access requirements.

Higher fills impair manageability, increase the risk of overheating, and limit the capacity to pull fibre cables without causing damage. These ranges align with the logic behind widely cited pathway guidance including standards-derived conduit fill tables.

Visual Fill vs. Usable Capacity

Looks OK

40- 50% fill, clear bend envelopes, edge working space

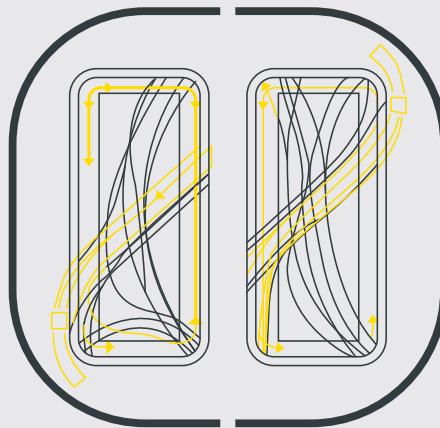

Operationally Congested

Higher fill, overlapping bends, no corner working space

Pathway congestion is often caused by loss of usable routing space, not just total cross-sectional area. A duct that appears partially occupied may already be functionally congested at critical transition points.

Elevate's Published Capacity References

Elevate's Yellow Fibre Duct documentation provides capacity guidance based on duct widths and fill ratios (50% / 75% / 100%) and fibre diameter assumptions, supporting structured scoping rather than guesswork. These published physical fill capacities support accurate engineering and comparison - operational best practice is to design and manage pathways well below those limits to preserve accessibility, bend radius compliance, and future change velocity.

Bend Radius: The Hidden Driver of Congestion and Risk

Bend Radius is Not Optional - It's Performance Protection

Exceeding minimum bend radius can introduce macrobend and microbend loss, and - critically - long-term reliability issues that may not manifest immediately but degrade performance over the infrastructure lifecycle. In high-density environments where fibre counts are increasing and cable diameters are decreasing, bend radius compliance becomes both more challenging and more consequential.

Commonly cited installation guidance includes the following multipliers, applied to cable outer diameter (OD):

~20× Cable OD

During pulling / installation under tension


~10× Cable OD

After installation / static minimum bend radius

These multipliers are widely used as general rules of thumb. Always refer to the specific cable manufacturer's datasheet for definitive values, particularly for high-fibre-count or bend-insensitive cable types.


Engineered Elbow

Uses proper accessory with minimum bend radius envelope.

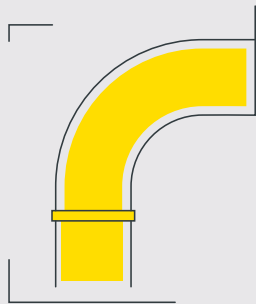

Forced Tight Bend

Congestion causes bend beyond safe radius; high risk zone.

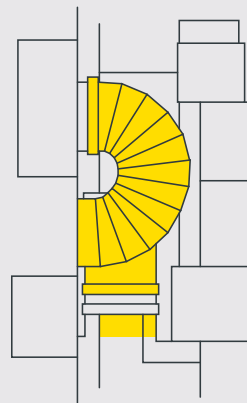

Bend-radius envelopes at elbows and tees consume space and drive risk when pathways are densely packed. Purpose-designed accessories are not optional extras - they are fundamental to compliant pathway geometry.

What This Means for Duct Design

Every direction change - 90°, 45°, tee, or drop-off - creates a bend envelope: an exclusion zone where cables must be guided to maintain radius compliance. In congested ducts, technicians compensate by forcing tighter turns, stacking bundles, or rerouting in ways that increase risk and accelerate cable degradation. This is not a hypothetical failure mode; it is a documented consequence of reactive, fill-to-capacity pathway management.

Use Purpose-Designed Elbows and Tees

Direction changes should always use purpose designed elbows, tees, and junction accessories rather than improvised bends. These components define the geometry of the turn, removing ambiguity and protecting cable performance.

Standardise and Distribute Drop Points

Drop points should be standardised in design and distributed along routes to avoid concentrated congestion hotspots. Ad-hoc drops accumulate into significant congestion within short periods in high-change environments.

Elevate Accessory Ecosystem

Elevate's duct ecosystem explicitly includes a broad range of routing accessories - bends, tees, junctions, risers, and exit sections - enabling engineered turns and transitions rather than ad-hoc routing that compromises both performance and future access.

Engineering Strategies to Manage Congestion

Segment Pathways (Zoning) to Reduce Cross-Traffic and Risk

Pathway zoning is one of the most effective structural interventions available to consultants designing new environments or auditing existing ones. By creating logical zones within the overhead pathway infrastructure, operators can contain the blast radius of change activity, protect critical services, and simplify governance over time.

Create zones by three primary criteria:

Function

Backbone trunk routes separated from high-churn patching and cross connect zones.

Criticality

Protected routes for high-availability services, isolated from routine change activity.


Media Type

Fibre separation from other services for mechanical protection and management discipline.

Elevate's fibre duct approach explicitly emphasises the importance of separating delicate, small-diameter fibre for mechanical protection and controlled routing - a principle that should be embedded in the pathway design specification from day one.

Add Parallel Capacity Before Re-mediation

A common and costly failure pattern is attempting to “tidy up” a congested route with no alternate path available. The lower-risk method is a structured, staged migration approach that allows re mediation without forcing dangerous short cuts in a live environment.

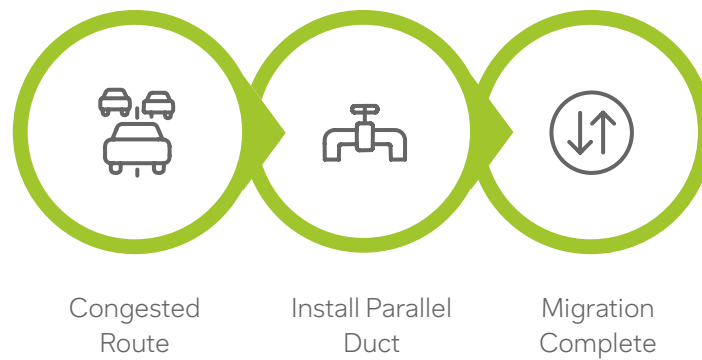

Parallel capacity enables staged migration and reduces intervention risk in live environments. This approach reassures operators that remediation does not require service disruption.

The staged approach – (1) install parallel duct, (2) migrate high-churn or non-critical circuits first, (3) re-home legacy runs during planned windows – reduces live handling risk and allows remediation without forcing dangerous shortcuts. Maintainability is itself a component of capacity.

Standardise Entry/Exit Points and Enforce Routing Rules

Congestion is frequently created by uncontrolled “wherever it fits” drop-offs that accumulate over time as teams and contractors exercise discretion in the absence of defined standards. A modest governance investment at design stage eliminates this pattern and preserves pathway performance over the infrastructure lifecycle.

Defined Drop Zones

Consistent, pre-designed transitions at defined positions along trunk routes, preventing ad-hoc exits that create localised congestion hotspots.

Labelling and Route Documentation

Route documentation expectations embedded in the specification and handover requirements, ensuring post-installation maintainability rather than post-handover entropy.

Duct Occupancy Register


A lightweight governance step for pathway utilisation – even a simple duct occupancy register for critical routes provides the visibility needed to trigger remediation before congestion becomes critical.

Designing for Future Capacity: A Model Consultants Can Defend

Forecast Ranges, Not Single Numbers

Rather than designing fibre pathways for a single forecast - “we need X fibres in this route” - best practice is to allow for a range of growth scenarios, ensuring the pathway remains accessible and manageable even if fibre volumes and change activity increase faster than anticipated. Single-point forecasts are rarely accurate over a five-to-ten year infrastructure horizon; pathway design should reflect this reality rather than assume precision that does not exist.

The practical implication is that initial pathway utilisation should be deliberately conservative, with headroom reserved not merely for additional fibre count, but for the change activity associated with those fibres: the moves, the re-routes, the remedial work, and the parallel installation events that characterise a live data centre environment.

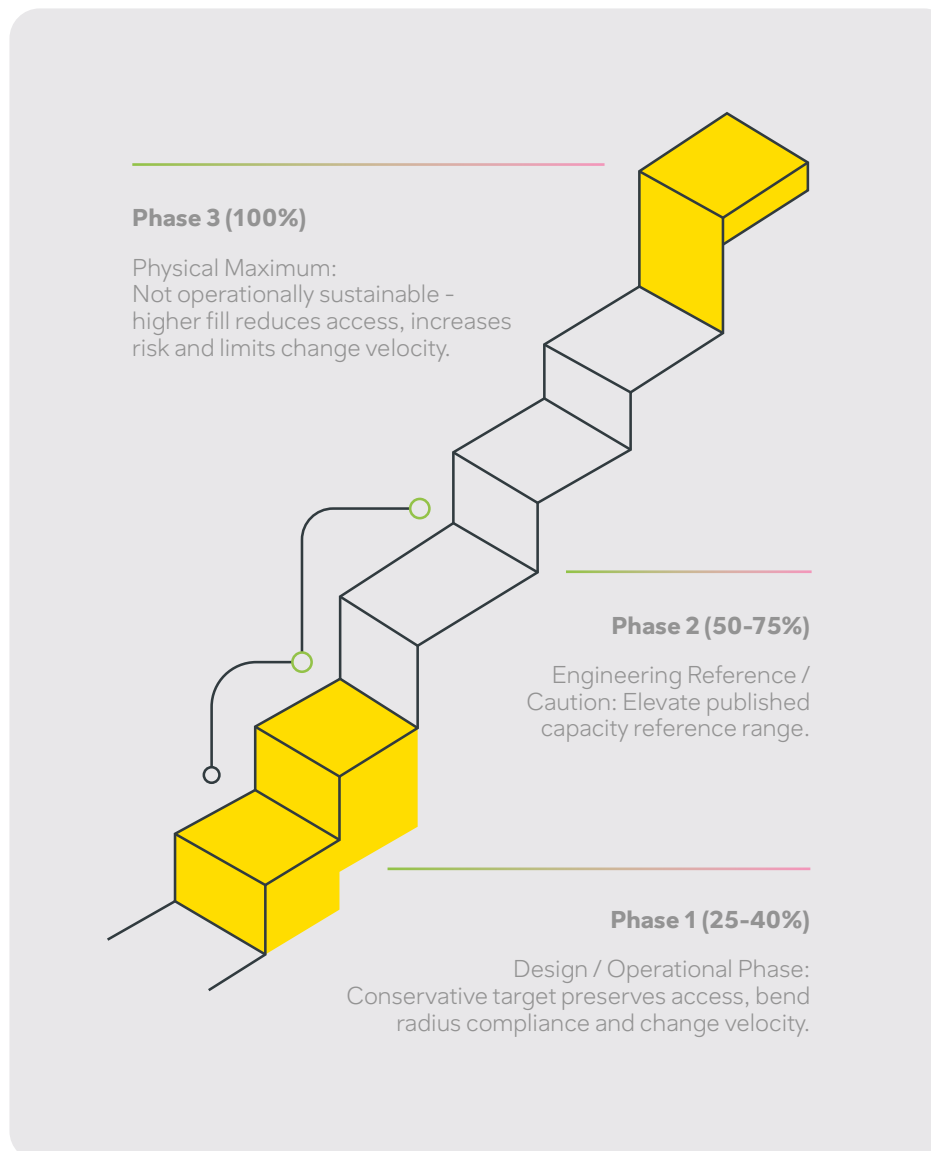

Use Modularity as a Contingency Against Uncertainty

Modularity is the engineering response to forecast uncertainty. Rather than attempting to size pathways perfectly for a future that cannot be known precisely, a modular system enables iterative, incremental expansion that matches the actual pace of demand rather than a projected one.

Elevate's Yellow Fibre Duct is engineered with modularity as a structural principle, not a marketing claim:

Modular Straight Sections


Straight sections and accessories support iterative expansion and reconfiguration without disturbing existing installed routes.

Multiple Widths, Consistent Height

Multiple width options with a consistent 100 mm height profile enable predictable, repeatable design rules across the entire site.

Standard 2000 mm Lengths

Supplied in standard 2000 mm lengths, simplifying standardisation, stock management, and spares strategy across multi-site or long-term programmes.

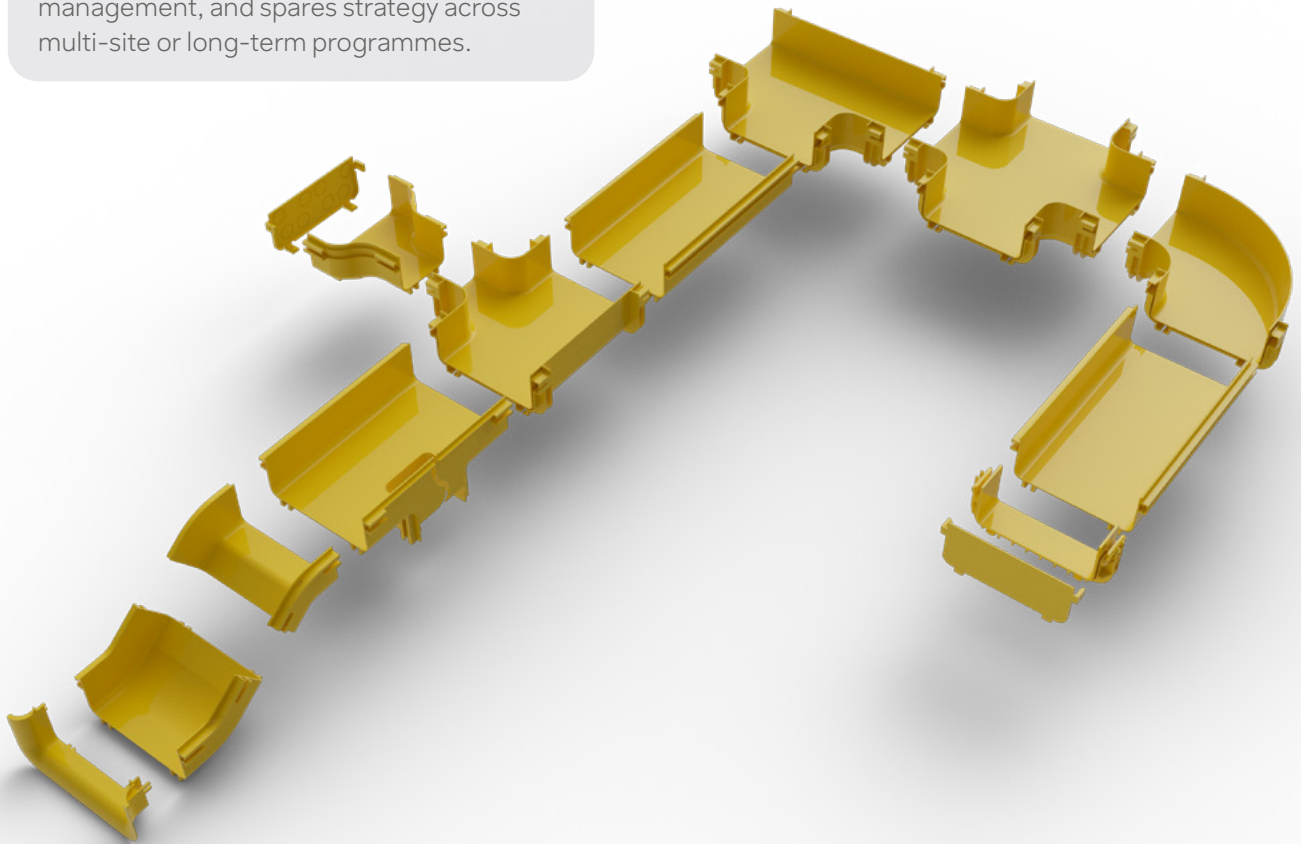

Treat Capacity as a Controlled Asset

The most effective long-term governance method is simple to implement but requires organisational commitment. Assign each trunk route a target design fill – typically 30 - 40% – track changes against that target, and define a redesign trigger when utilisation crosses a defined threshold. This avoids the common lifecycle failure where ducts slowly exceed manageable fill and are only addressed after incidents or project delays have forced the issue.

Pathway capacity should be treated with the same governance discipline as rack power capacity or switch port utilisation. Without a defined threshold and a defined owner, congestion is not a matter of if, but when.

Fire Safety and Material Performance: Why It Belongs in the Specification

Data centre pathway components are part of the built environment and must support fire safety objectives – not merely satisfy a minimum compliance threshold. Material selection for overhead fibre ducting has direct implications for smoke density, toxic gas generation, and structural integrity under fire conditions, all of which affect evacuation safety, equipment survivability, and post-incident recovery.

Flame-Retardant ABS Construction

The Elevate Yellow Fibre Duct system is manufactured from flame-retardant ABS with Low Smoke Zero Halogen (LSZH) characteristics. The material selection is specifically intended to limit smoke density and the release of toxic or corrosive byproducts under fire conditions – characteristics directly relevant to data centre environments with high-density electronic equipment and occupied technical spaces.

UL94 V-0 Flammability Rating

The system meets UL94 V-0 flammability requirements – the highest classification within the UL94 standard, indicating that the material self-extinguishes within a defined period and does not drip flaming particles. This is the specification benchmark for data centre pathway components in compliance-conscious procurement frameworks.

Regulatory and Environmental Compliance

The system aligns with relevant regulatory and environmental compliance frameworks including RoHS (Restriction of Hazardous Substances), the Waste Framework Directive, SCIP (Substances of Concern In articles as such or in complex objects/Products), and POPs (Persistent Organic Pollutants). For procurement teams operating within ESG reporting frameworks or public-sector compliance environments, this provides a documented basis for material selection decisions.

Why Material Specification Matters at Design Stage

Fire safety material performance is most effectively addressed at specification stage, not substituted post-award. Once a pathway system is installed and populated with live fibre, replacing components for compliance reasons becomes a significant operational risk event in its own right.

Specifying LSZH, flame-retardant pathway components from the outset – backed by published compliance certifications – eliminates this risk and provides a defensible audit trail for the design team, the contractor, and the end-user client.

UL94 V-0

Flammability classification

LSZH

Low Smoke Zero Halogen

RoHS

Hazardous substance restriction

Where Elevate Yellow Fibre Duct Fits: A Pathway Platform for Governed Growth

Elevate as a Pathway Platform

The Elevate fibre duct system is positioned as a modular range of straight trunking and accessories designed for overhead routing environments and fast installation. It is explicitly designed to integrate with other Elevate infrastructure components, supporting a cohesive data centre environment rather than functioning as a standalone, isolated product selection.

The distinction between a “product” and a “platform” is operationally significant. A product satisfies a point-in-time requirement. A platform provides the geometry, the accessories, and the governance framework to support the full lifecycle of a pathway – from initial installation through growth, change, and eventual reconfiguration.

What Makes This Useful to Operators and Consultants

From a technical standpoint, the value proposition rests on four mutually reinforcing properties that collectively reduce the gap between design intent and operational reality:

Standardised Design Geometry

Consistent height profile, defined widths, and standard lengths – enabling repeatable, predictable design rules across the entire site and across multiple projects.

Engineered Routing

A comprehensive accessory set for turns, junctions, tees, risers, and exit sections – replacing improvised bends with defined, compliant transitions.

Conservative Capacity Planning

Published capacity references that support structured scoping, with clear guidance that operational design targets should remain well below physical maximums.

Safety-Led Material Selection

LSZH, flame-retardant construction with published compliance certifications – providing a defensible specification basis for procurement and audit.

Technical Field Checklists:

Assessing Pathway Congestion, Risk, and Future Readiness

The following check-lists support site walks, audits, and consultant reviews. They are structured to provide fast, auditable assessments of whether fibre duct pathways are operating within a safe and manageable envelope, and whether they are positioned to scale cleanly as demand increases.

Indicators of Pathway Congestion and Elevated Operational Risk

Pathway Utilisation and Access

- ☐ Duct routes are visually crowded, with limited free space at entry and exit points
- ☐ Technicians struggle to add new fibres without disturbing existing bundles
- ☐ Temporary removal or repositioning of live fibres is required to complete MAC work
- ☐ Duct covers are difficult to remove or refit due to internal congestion

Bend Radius and Fibre Handling Risks

- ☐ Tight turns are visible at elbows, tees, or drop-off points
- ☐ Fibre bundles are forced against duct edges or corners
- ☐ Multiple fibres are stacked or compressed at direction changes
- ☐ Entry/exit points lack defined radius control or strain relief

Change Velocity and Operational Pressure

- ☐ The route is subject to frequent adds, moves, or changes
- ☐ Multiple teams (network, projects, contractors) access the same pathway
- ☐ Changes are increasingly planned around “how to make it fit” rather than following a standard route
- ☐ Planned work durations are increasing due to pathway constraints

Governance and Documentation

- ☐ No defined design fill or utilisation threshold exists for the route
- ☐ Pathway ownership and routing rules are unclear or unenforced
- ☐ Labelling and route documentation is inconsistent or outdated

If three or more boxes are ticked, the pathway should be treated as congested and reviewed for remediation or parallel capacity installation.

Indicators That Future Capacity and Scalability Are at Risk

Capacity Planning Assumptions

- ☐ Pathway was designed to a single fibre forecast with no allowance for accelerated growth
- ☐ Growth assumptions did not account for increased change frequency
- ☐ No reserved space or parallel routes were identified for future expansion

Physical Constraints

- ☐ Duct width or height limits the ability to add parallel routes later
- ☐ Existing duct routes block access to alternative expansion corridors
- ☐ Transitions between trunk routes and racks are already at high utilisation

Modularity and Adaptability

- ☐ The duct system does not support easy extension or reconfiguration
- ☐ Direction changes rely on improvised routing rather than engineered accessories
- ☐ Expansion would require significant removal of existing services

If these conditions exist, future growth is likely to trigger reactive rework rather than planned expansion – with associated cost and risk implications that compound over the infrastructure lifecycle.

Design and Remediation Best Practice Checks

Pathway Design Discipline

- ✓ Initial pathway utilisation is deliberately conservative rather than maximised
- ✓ High-change routes are treated differently from stable backbone routes
- ✓ Entry/exit points are standardised and evenly distributed

Modular Expansion Strategy

- ✓ Parallel duct routes can be added without disturbing live services
- ✓ The duct system supports consistent geometry across sizes and routes
- ✓ Accessories are used to manage turns, transitions, and junctions rather than forcing fibres

Risk Reduction Measures

- ✓ Bend radius control is maintained at all direction changes
- ✓ Fibre bundles are supported and separated to reduce mechanical stress
- ✓ Pathway layout minimises the need for hands-on interaction with live fibres

Governance, Lifecycle Control, and What “Good” Looks Like

Governance and Lifecycle Control Checklist

This checklist supports consultants and operators who require pathway performance to remain predictable over time – the fundamental objective of any infrastructure governance programme.

Operational Controls

- ✓ A target design fill (or utilisation band) is defined for each critical route
- ✓ Thresholds exist that trigger review or expansion before congestion occurs
- ✓ Changes are assessed against pathway capacity, not just rack availability

Documentation and Accountability

- ✓ Pathway layouts are documented and kept current
- ✓ Ownership of pathway standards is clearly defined
- ✓ Contractors and internal teams follow the same routing rules

Long-Term Readiness

- ✓ Pathways are treated as critical infrastructure, not passive containment
- ✓ Expansion plans include physical routing, not just fibre counts
- ✓ The system supports controlled growth rather than reactive densification

What “Good” Looks Like – Summary for Decision Makers

A well-designed yellow fibre duct strategy delivers five measurable operational outcomes:

Access and Compliance Under Change

Preserves bend radius compliance and hands-on access even as fibre counts and change activity increase.

Supports Accelerated Growth

Accommodates faster-than-forecast growth without forcing rework or service interruption.

Reduces Live MAC Risk

Minimises operational risk during live moves, adds, and changes – protecting service continuity.

Enables Modular Expansion

Supports predictable, incremental expansion in defined, repeatable increments.

Aligns with Real-World Velocity

Matches physical infrastructure capacity to actual change velocity rather than static design assumptions.

Designing Pathways for Change, Not Just Capacity

Pathway congestion within fibre ducting is rarely the result of a single poor decision. More often, it is the cumulative effect of growth, increasing change velocity, and infrastructure that was designed to meet a fixed requirement rather than an evolving operational reality.

As data centres scale – in density, in connectivity, and in the frequency with which those connections must be reconfigured – the challenge is no longer simply how many fibres can be installed, but how safely, predictably, and repeatedly those fibres can be added, moved, and re-routed over time.

Congested pathways increase operational risk, slow delivery, and drive costly rework – often long before physical capacity limits are reached. A structured approach to pathway design, grounded in conservative utilisation targets, modular expansion, and clear governance, allows operators and consultants to protect change velocity while maintaining confidence in future capacity.



Designing for headroom, access, and adaptability is not inefficiency – it is a deliberate strategy to reduce lifecycle risk. The difference between a data centre pathway that supports sustained operational performance and one that becomes a constraint and a liability is not the number of fibres installed on day one. It is the extent to which the design anticipated the rate of change that would follow.

A structured approach to pathway design, grounded in conservative utilisation targets, modular expansion, and clear governance, allows operators and consultants to protect change velocity while maintaining confidence in future capacity. The checklists, design principles, and engineering frameworks set out in this whitepaper provide a practical basis for that approach – applicable both to new builds and to the audit and remediation of existing environments.

Elevate's Yellow Fibre Duct ecosystem supports this approach by enabling consistent geometry, engineered routing, and scalable expansion as part of a wider data centre infrastructure ecosystem. Used correctly, it allows pathways to be treated as a managed, long-term asset – governed, documented, and expandable – rather than a constraint that must be remediated under pressure.

In an environment where uncertainty is inevitable, the most resilient data centres are those designed not just for today's fibre counts, but for tomorrow's rate of change. Pathway capacity is not a static specification to be satisfied at handover; it is a dynamic resource to be managed, governed, and protected across the full infrastructure lifecycle.

Conservative Design Targets

25–40% initial fill for high-change routes – headroom is a feature, not waste.

Modular, Scalable Systems


Consistent geometry and a full accessory set enable predictable, incremental growth.

Engineered for Change Velocity

Pathway performance maintained under the pace of MAC activity in live environments.

Clear Governance Framework

Defined utilisation thresholds, documented ownership, and consistent routing rules.

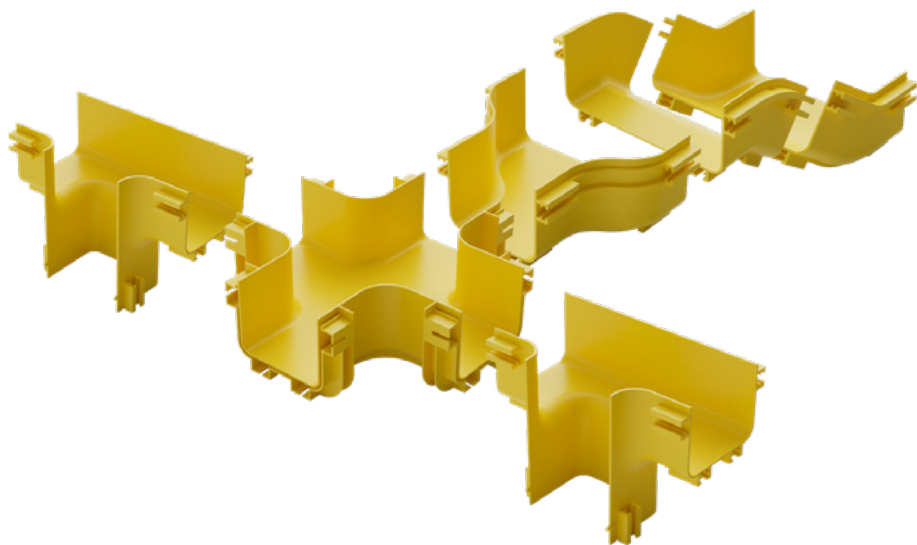

ELEVATE

Future Faster

elevate@excel-networking.com

elevate.excel-networking.com